



## APPENDIX B — FINA DIMENSIONS FOR DIVING FACILITIES

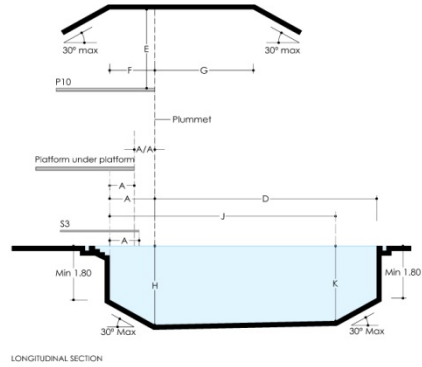

LONGITUDINAL SECTION

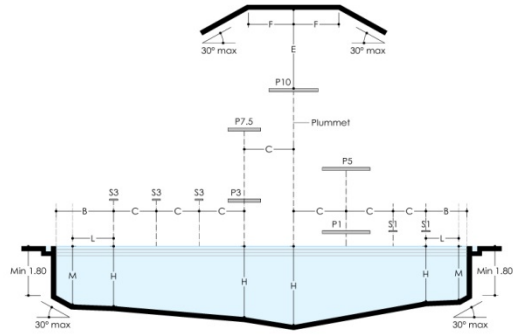

CROSS SECTION

FINA	Dimensions for Diving Facilities	SPRINGBOARD			PLATFORM			10-meter
		1-meter	3-meter	1-meter	3-meter	5-meter	7.5-meter	
	For pools constructed after Sept. 26, 2013 (See FR 5.3.1)	4.80	4.80	5.00	5.00	6.00	6.00	6.00
	Length	0.50	0.50	1.00 min, 2.90 pref	1.00 min, 2.00 pref	2.90	2.00	3.00
	Width	1.00	3.00	0.60 min, 1.00 pref	2.60 min, 3.00 pref	5.00	7.50	10.00
	Height	Horiz	Vert	Horiz	Vert	Horiz	Vert	Horiz
	Designation	A-1	A-3	A-1 pl	A-3 pl	A-5	A-7.5	A-10
	Minimum	2.22	2.22	.75	1.25	1.25	1.25	1.50
	Preferred	2.22	2.22	.75	1.25	1.25	1.25	1.50
	Minimum	1.50	1.50					
	Preferred	1.80	1.80					
	Designation					A/A 5/1	A/A 7.5/3.1	AA 10/5/3.1
	Minimum					0.75	0.75	0.75
	Preferred					1.25	1.25	1.25
	Designation	B-1	B-3	B-1 pl	B-3 pl	B-5	B-7.5	B-10
	Minimum	2.50	3.50	2.50	3.00	4.00	4.50	5.75
	Preferred	2.50	3.50	3.50	3.60	4.50	4.75	5.75
	Designation	C-1-1	C3-3, 3-1	C-1-1 pl	C3-3pl 1pl	C5-3, 5-1	C7-5, 5, 3, 1	C10-7.5, 5, 3, 1
	Minimum	2.00	2.20	1.85	2.20*	2.85*	2.75*	3.00*
	Preferred	2.00	2.60	2.15	2.35*	2.85*	2.75*	3.00*
	Designation	D-1	D-3	D-1 pl	D-3 pl	D-5	D-7.5	D-10
	Minimum	9.00	10.25	8.00	9.50	10.25	11.00	13.50
	Preferred	9.00	10.25	8.00	9.50	10.25	11.00	13.50
	Designation	E-1	E-3	E-1 pl	E-3 pl	E-5	E-7.5	E-10
	Minimum	5.00	5.00	3.25	3.25	3.25	3.25	3.25
	Preferred	5.00	5.00	3.50	3.50	3.50	3.50	3.50
	Designation	F-1	F-3	F-1 pl	F-3 pl	F-5	F-7.5	F-10
	Minimum	2.50	2.50	2.75	2.75	2.75	2.75	2.75
	Preferred	2.50	2.50	2.75	2.75	2.75	2.75	2.75
	Designation	G-1	G-3	G-1 pl	G-3 pl	G-5	G-7.5	G-10
	Minimum	5.00	5.00	3.25	3.25	3.25	3.25	3.25
	Preferred	5.00	5.00	3.50	3.50	3.50	3.50	3.50
	Designation	H-1	H-3	H-1 pl	H-3 pl	H-5	H-7.5	H-10
	Minimum	3.40	3.70	3.20	3.50	3.70	4.10	4.50
	Preferred	3.50	3.80	3.30	3.60	3.80	4.50	5.00
	Designation	J-1	J-3	J-1 pl	J-3 pl	J-5	J-7.5	J-10
	Minimum	5.00	6.00	4.50	5.50	6.0	8.00	11.00
	Preferred	5.00	6.00	4.50	5.50	6.00	8.00	11.00
	Designation	L-1	L-3	L-1 pl	L-3 pl	L-5	L-7.5	L-10
	Minimum	1.50	3.30	1.40	1.80	3.40	3.75	4.50
	Preferred	2.00	3.40	1.90	2.30	3.50	3.70	4.40
	Designation							
	Minimum							
	Preferred							

**\*\*Note:** The minimum distance between adjacent platforms must be at least 0.25 meters.  
**Note:** Dimensions B (plummet to pool wall at side) and C (plummet to adjacent plummet) apply to platforms with widths as detailed in FR 5.2.5. If platform widths are increased then B and C shall be increased by half the additional width(s).  
**Note:** The 10-meter platform must project 0.25 meters beyond any adjacent platform. **Note:** All platforms must project 0.75 meters beyond the pool wall or beyond.  
**Note:** The leading edge of the concrete platforms for springboards must be at least constructed to be directly above the pool wall or beyond.  
**\*\*** USA Diving and FINA dimensions are the same with the exception of H. See Article 1, Section 101.1 (C)